

**NOTES**

- 1) ALL DIMENSIONS GIVEN IN INCHES UNLESS OTHERWISE SPECIFIED.
- 2) DESIGN CONDITIONS:  
 MAX PRESSURE 115 PSI  
 MAX TEMPERATURE 140 °F  
 192 GPM @ 70' TDH
- 3) APPROXIMATE MASS: 764 LBS (DRY)


#	COMPONENT
1	NEMA 4X, UL, 460V/3PH/60Hz CONTROL PANEL
2	FILTER: (x2) 3" TAF-750, 50 MICRON SCREEN
3	PUMP: 7.5HP 3600RPM, 460/3/60, 192 GPM @ 70' TDH
4	PURGE: 1-1/2" FLANGED
5	BASE: EPOXY COATED CARBON STEEL
6	FACE PIPE: 4" 304SS
7	ISOLATION VALVES: (x4) 4" GRUVLOK 7600 VALVE

**Amiad** WATER SYSTEMS  
 120-J TALBERT ROAD  
 MOORESVILLE, NC 28117  
 PH: (704) 662-3133  
 FAX: (704) 662-3155


THIS DRAWING, AND THE INFORMATION CONTAINED HEREIN, IS THE PROPERTY OF AMIAD WATER SYSTEMS. ANY USE OR REPRODUCTION THEREOF WITHOUT THE WRITTEN PERMISSION OF AMIAD WATER SYSTEMS ENGINEERING DEPARTMENT IS STRICTLY PROHIBITED.	
DRAWING DATE: 9/11/2015	DRAWING TITLE: FILTER SKID DUAL 3" TAF-750 With Pump and Controls
SCALE: 1:18	DRAWING NUMBER: <b>700301-000039</b>
SHEET 1 OF 2	CAT NUMBER: 700301-000039   REV. NO. 0
DRAWN BY: BJH	CHECKED BY: _____
APPROVED BY: _____	GENERAL TOLERANCES (EXCEPT AS NOTED): ANGULAR ± 1° FRACTIONAL ± 1/8" Dec: 2 PL ± 0.05", 3 PL ± 0.010"

NO.	REVISION NOTES	DATE	BY

460V/3 $\phi$ /60 Hz

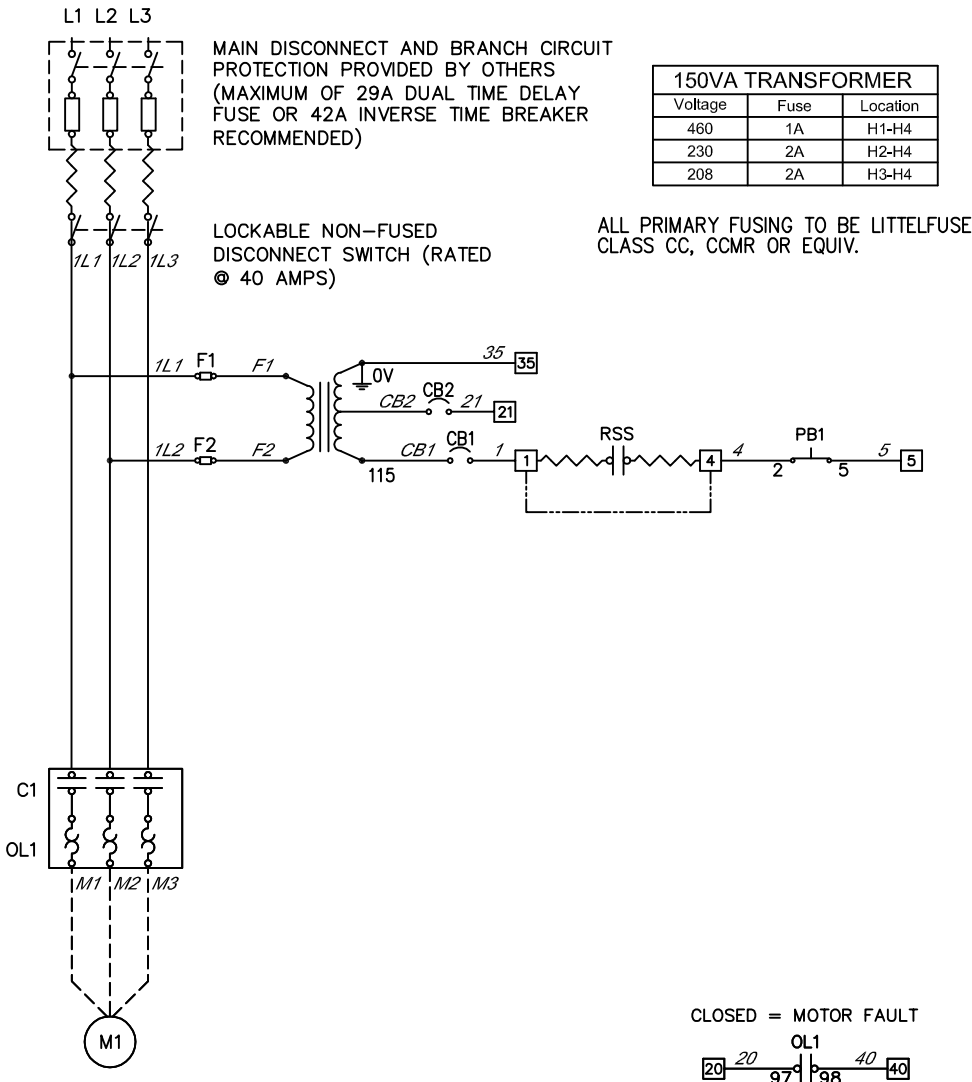

MAX. VOLTAGE: 600V  
MAX. AMPERES: 16A

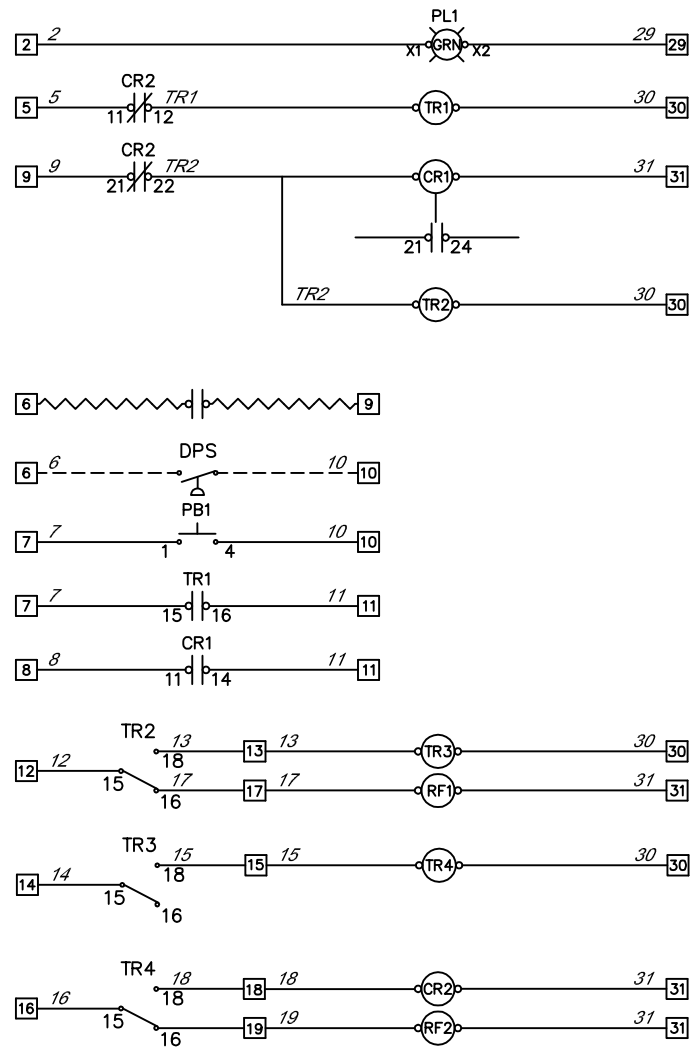

- POWER ON
- CYCLE TIMER (0.05S-60HRS)
- FLUSH CONTROL
- FLUSH IN PROGRESS
- FILTER 1 FLUSH DURATION
- REMOTE START
- DIFFERENTIAL PRESSURE
- FLUSH
- CYCLE TIMER
- TR3 DWELL TIMER
- FILTER 1 CONTROL
- TR4 FILTER 2 FLUSH DURATION
- RESET
- FILTER 2 CONTROL

POWER	POWER	460V/3~/60HZ
	TOTAL FLA	16.0
	SCCR	5 kA RMS SYMMETRICAL, 600V MAX.
	LARGEST MTR.	N/A


ENCLOSURE	STANDARD	UL 508A
	SIZE	16"L x 14"W x 7"D
	UL RATING	TYPE 4X
	MATERIAL	POLYCARBONATE

- GROUND PER 2011 NATIONAL ELECTRICAL CODE ARTICLE 250.
- PANEL WIRING: \_\_\_\_\_  
FIELD WIRING: \_\_\_\_\_  
CUSTOMER'S WIRING: \_\_\_\_\_  
FACTORY INSTALLED JUMPER: \_\_\_\_\_
- USE COPPER WIRE RATED 60°C MINIMUM UNLESS OTHERWISE SPECIFIED.
- DISCONNECT SWITCH TORQUE REQUIREMENTS: 35 LB IN. CONTACTOR/OVERLOAD TORQUE REQUIREMENTS: 7-10 LB IN.
- SIZE THE MAIN DISCONNECT AND BRANCH CIRCUIT PROTECTION PER 2011 NATIONAL ELECTRIC CODE ARTICLE 430.


- CONDUIT HUBS AND FITTINGS MUST HAVE THE SAME UL ENVIRONMENTAL RATING AS THE CONTROL PANEL ENCLOSURE.
- WIRE COLORS ARE AS FOLLOWS-LINE=BLACK, AC=RED, NEUTRAL=WHITE, DC+=BLUE, DC-=WHITE/BLUE, GROUND=GREEN/YELLOW, EXTERNAL SOURCE=YELLOW.

**Amiad**® WATER SYSTEMS 120-J TALBERT ROAD MOORESVILLE, NC 28117 USA (704) 662-3133 FAX (704) 662-3155


THIS DRAWING AND THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF AMIAD WATER SYSTEMS. ANY USE OR REPRODUCTION THEREOF WITHOUT THE WRITTEN PERMISSION OF AMIAD WATER SYSTEMS ENGINEERING DEPARTMENT IS STRICTLY PROHIBITED.			
DRAWING DATE: 11/18/2015		DRAWING TITLE: 2F 460V/3~ TAF 3.2-16A WIRING DIAGRAM	
SCALE: 1" = 1"		DRAWING NUMBER: 720102-000660-ELC	
SHT. 1 of 3		REV. NO. 0	
DRAWN BY: RAM		CATALOG NUMBER: 720102-000660	
NO.	DATE	NOTES	BY
GENERAL REVISIONS			
APP. BY: _____		GENERAL TOLERANCES (EXCEPT AS NOTED)	ANGULAR ±1° FRACTIONAL ± 1/8" DEC: 2PL±0.05", 3PL±0.010"




FILTER 1 FLUSH VALVE




FILTER 1 DRIVE MOTOR



FILTER 2 FLUSH VALVE



FILTER 2 DRIVE MOTOR

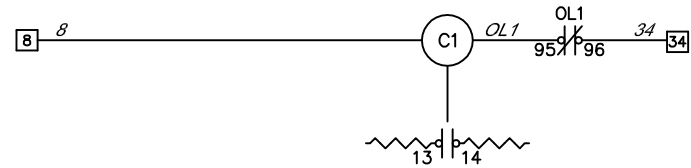


SYSTEM PUMP

MOTOR ON DRY CONTACTS

**amiad**® WATER SYSTEMS 120-J TALBERT ROAD  
MOORESVILLE, NC 28117 USA  
(704) 662-3133 FAX (704) 662-3155


THIS DRAWING AND THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF AMIAD WATER SYSTEMS. ANY USE OR REPRODUCTION THEREOF WITHOUT THE WRITTEN PERMISSION OF AMIAD WATER SYSTEMS ENGINEERING DEPARTMENT IS STRICTLY PROHIBITED.

DRAWING DATE: 11/18/2015		DRAWING TITLE: 2F 460V/3~ TAF 3.2-16A WIRING DIAGRAM	
SCALE: 1" = 1"		DRAWING NUMBER: 720102-000660-ELC	
SHT. 2 of 3		REV. NO. 0	
DRAWN BY: RAM		CATALOG NUMBER: 720102-000660	
NO.	DATE	NOTES	BY
GENERAL REVISIONS			
APP. BY: ---		GENERAL TOLERANCES (EXCEPT AS NOTED)	ANGULAR ±1° FRACTIONAL ± 1/8" DEC: 2PL±0.05", 3PL±0.010"


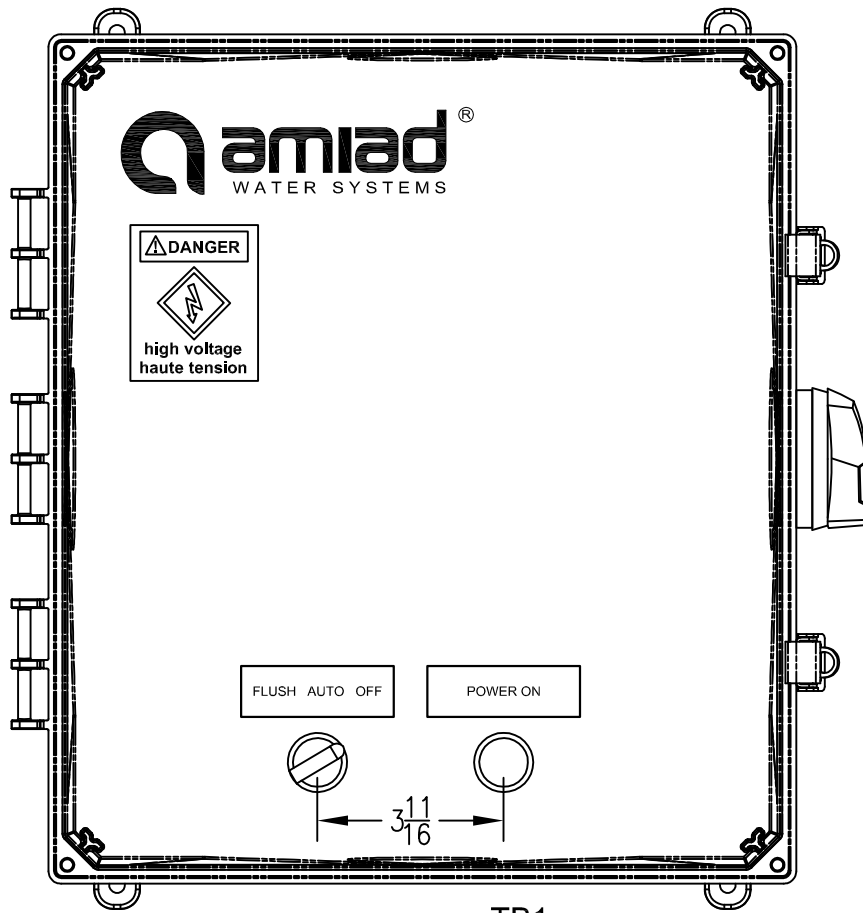


TB1

UPPER LEVEL



LOWER LEVEL

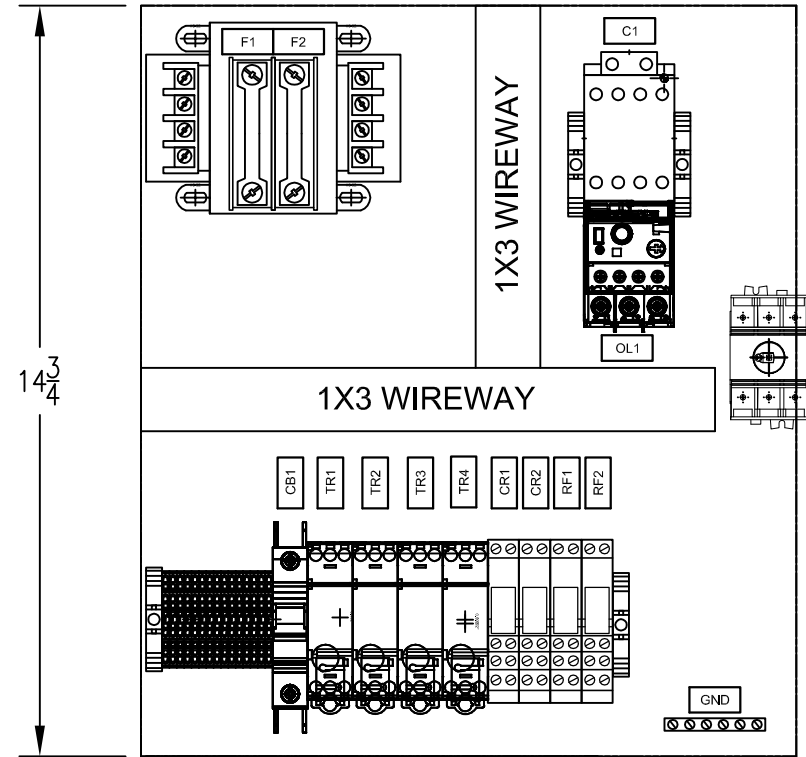

NOTE

1. ALL HARDWARE WILL INCLUDE ONE MECHANICAL LOCK AND A FLAT WASHER.
2. THE ONLY EXCEPTION IS IF THE MECHANICAL SCREW IS A SELF-THREADING SCREW.
3. IF BOLT/SCREW NEEDS TO GO THROUGH A THROUGH-HOLE, THE BOLT/SCREW WILL NEED A FLAT WASHER ON BOTH SIDES OF THE MATERIAL AND MECHANICAL LOCK BEFORE THE NUT.
4. ALL HARDWARE HAS TO THREAD AT LEAST TWO COMPLETE TURNS THROUGH THE NUT/THREADED HOLE
5. IF VISIBLE, NO HARDWARE WILL EXTEND PAST THREE THREADS OUT OF THE NUT/THREADED HOLE.
6. BACKPLANE AND DEAD FRONT IF REQUIRED ARE TO BE GROUNDED ACCORDING NEC 70E.
7. UNLESS OTHERWISE NOTED, ALL CONTACTORS WILL BE AB 100-C, OVERLOADS AB 193 E-1, CONTROL RELAYS AB 700-HLT, AND CIRCUIT BREAKERS AB 1489.

**Amiad**® WATER SYSTEMS 120-J TALBERT ROAD  
MOORESVILLE, NC 28117 USA  
(704) 662-3133 FAX (704) 662-3155

THIS DRAWING AND THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF AMIAD WATER SYSTEMS. ANY USE OR REPRODUCTION THEREOF WITHOUT THE WRITTEN PERMISSION OF AMIAD WATER SYSTEMS ENGINEERING DEPARTMENT IS STRICTLY PROHIBITED.

DRAWING DATE: 11/18/2015	DRAWING TITLE: 1F 460V/3~ TAF 3.2-16A WIRING DIAGRAM	
SCALE: 1" = 4"	DRAWING NUMBER: 720102-000660-ELC	REV. NO. 0
SHT. 3 of 3	CATALOG NUMBER: 720102-000660	
DRAWN BY: RAM	GENERAL TOLERANCES (EXCEPT AS NOTED)	ANGULAR ±1° FRACTIONAL ± 1/8" DEC: 2PL±0.05", 3PL±0.010"
NO. DATE	NOTES	BY
GENERAL REVISIONS		
APP. BY: ---	CHKD BY: ---	